




160411 bldll evaporator water temp vs time

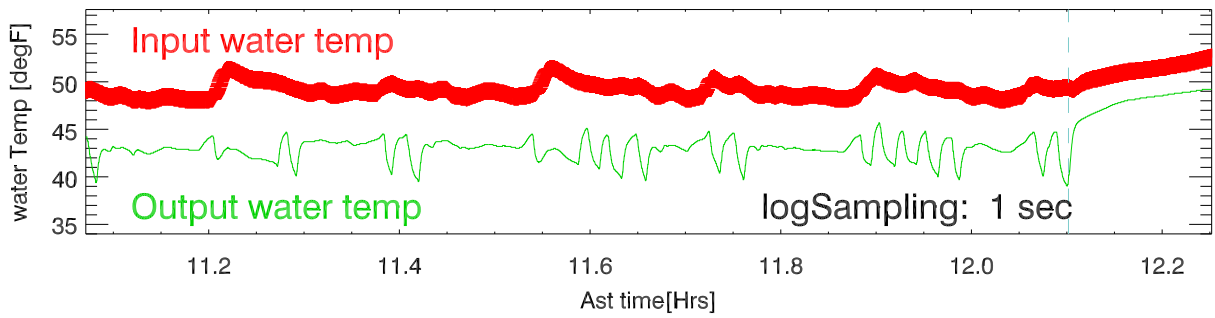


input - output water temp

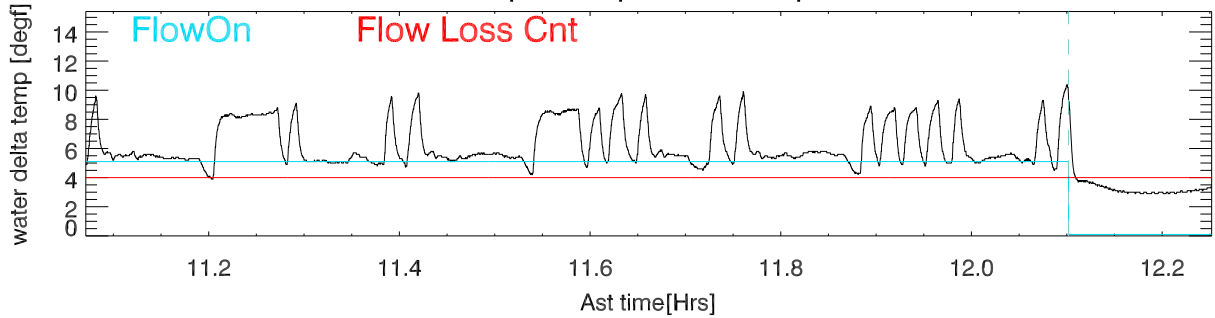


evaporator approach temp (refrigerant)

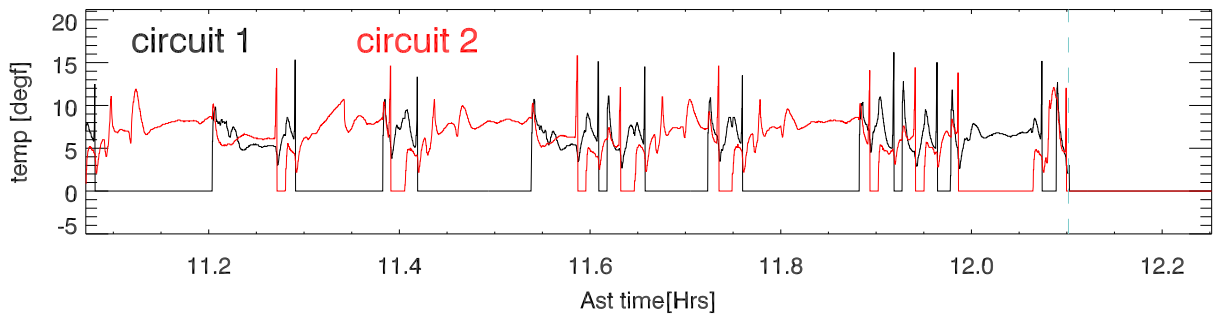


Suction saturated refrig temp

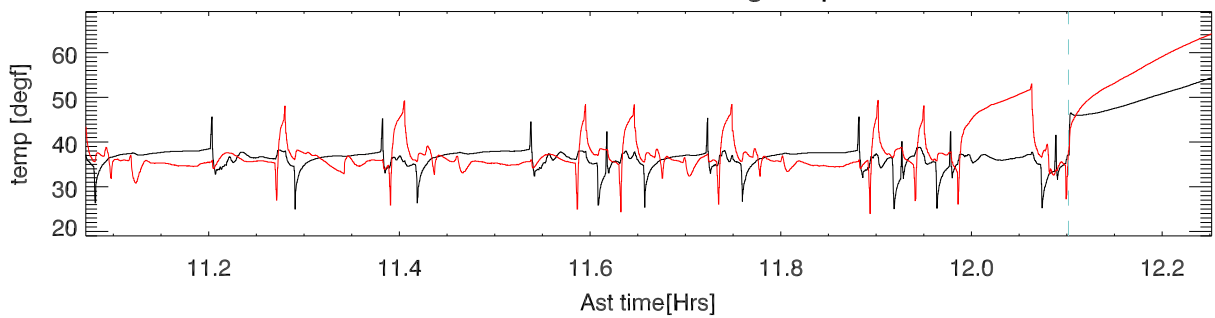


discharge saturated refrig temp

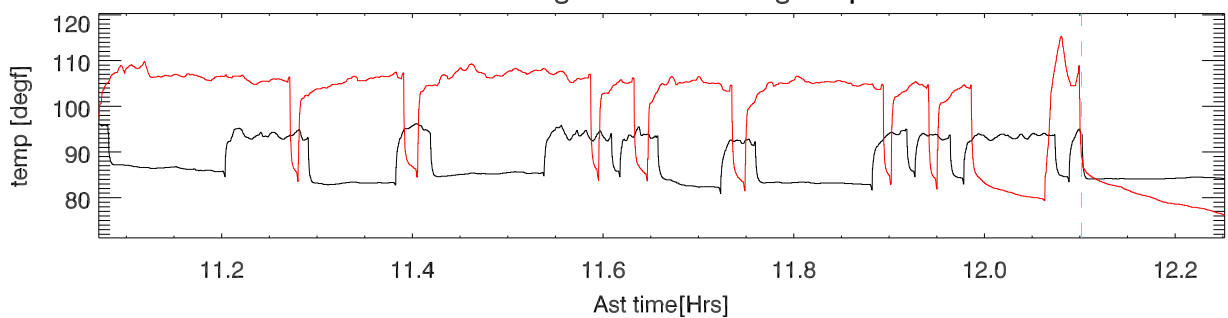


160411 suction pressure

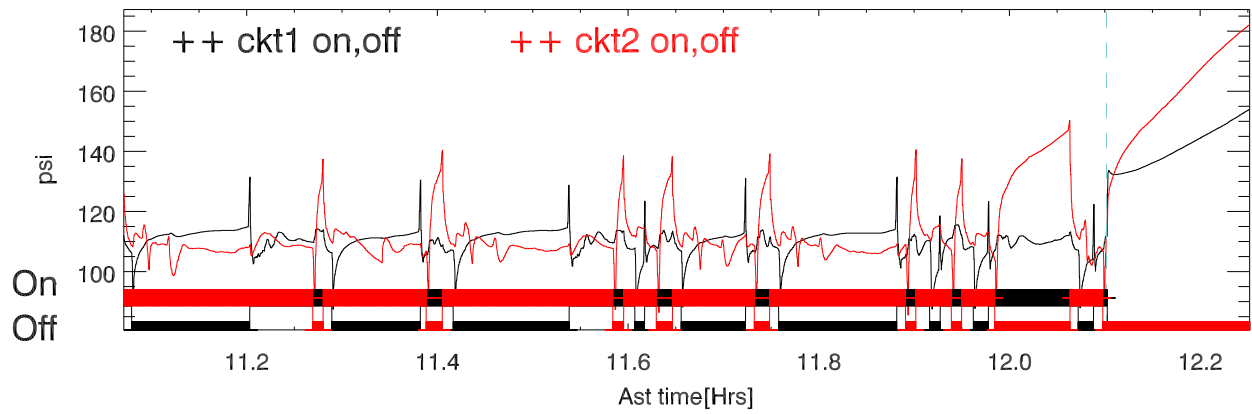


160411 discharge pressure

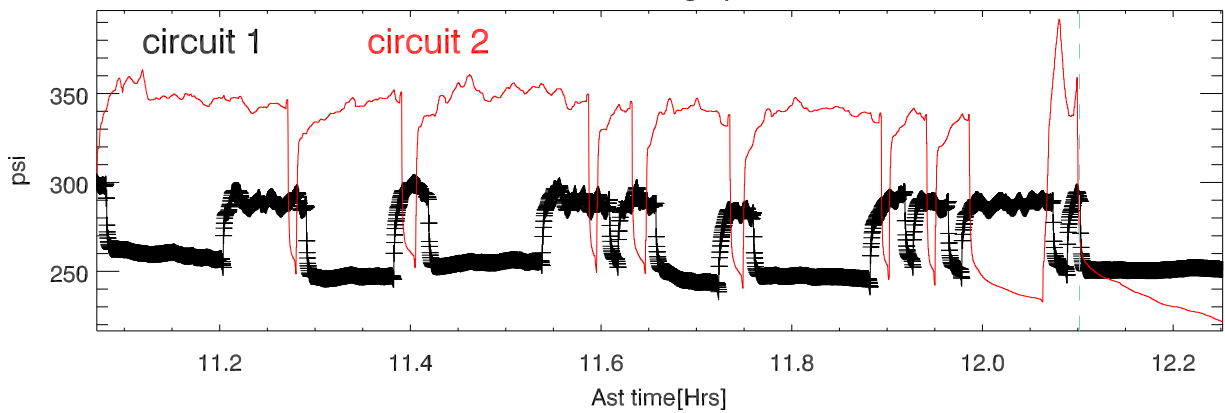


160411 differential refrigerant pressure

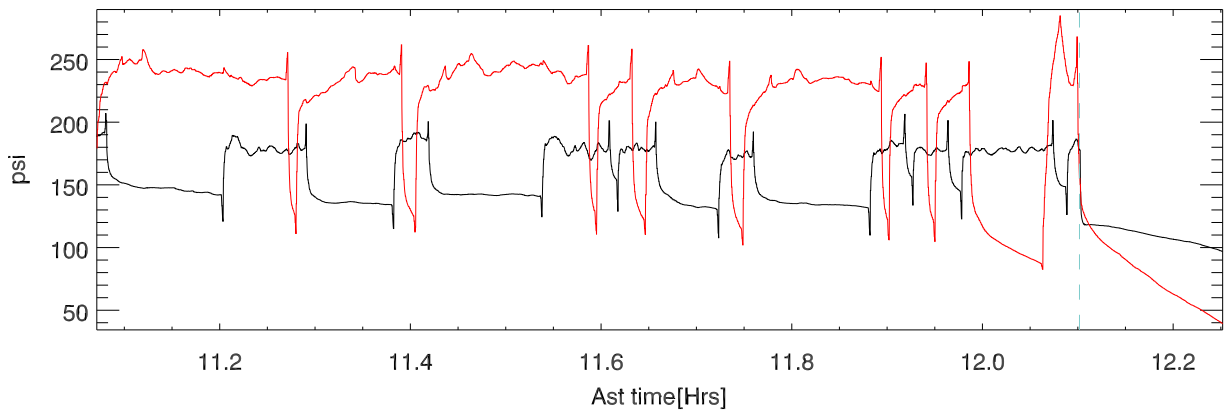


160411 expansion valve, flow command

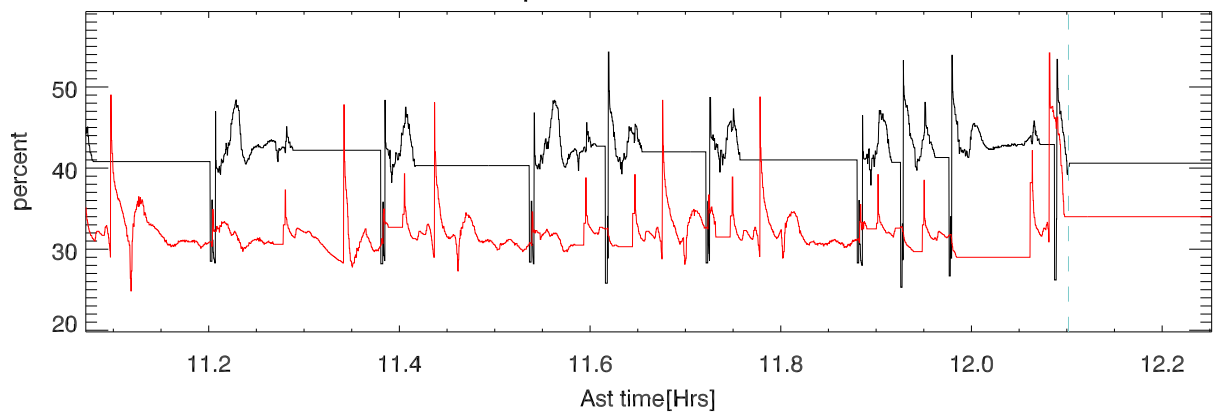


160411 bldll evaporator water temp vs time

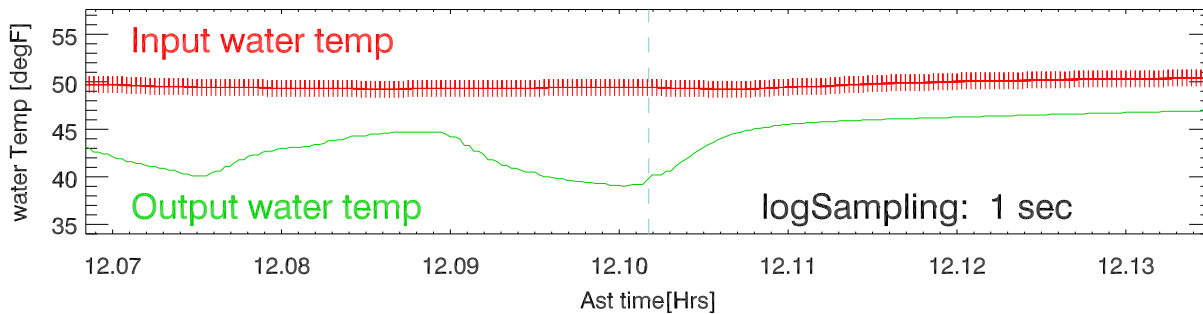


input - output water temp

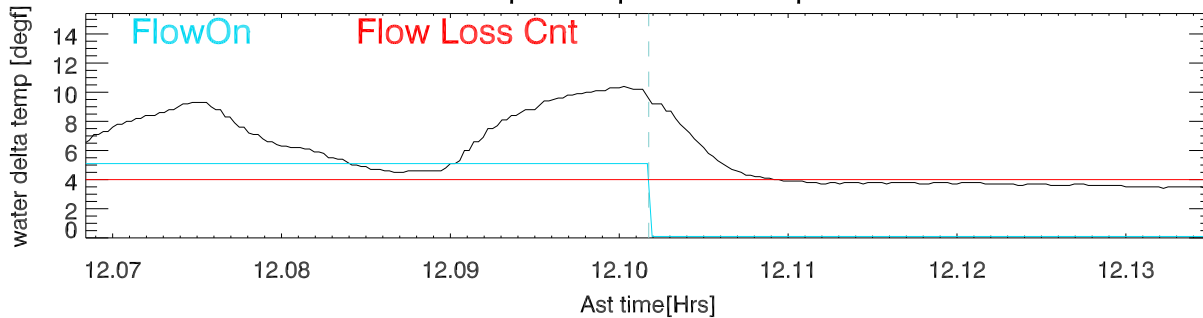

evaporator approach temp (refrigerant)

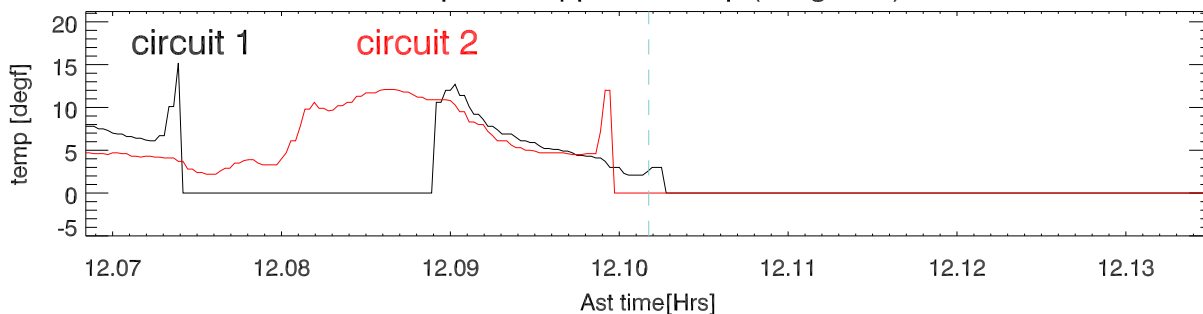

Suction saturated refrig temp

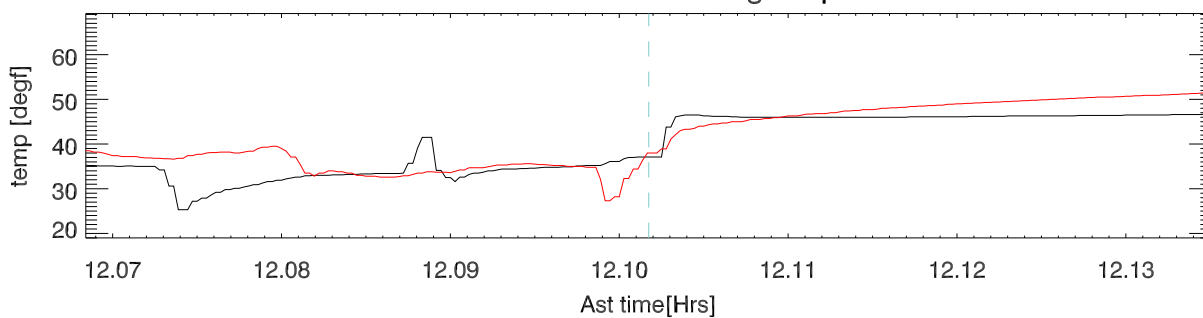

discharge saturated refrig temp

