




Cable temps vs hour of day. Main Cables for 20201012

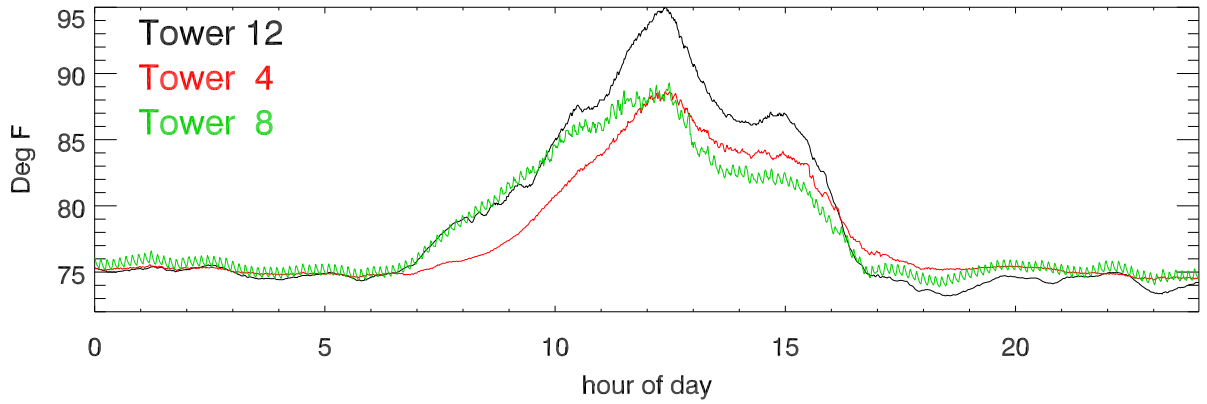


Backstay Cables for 20201012

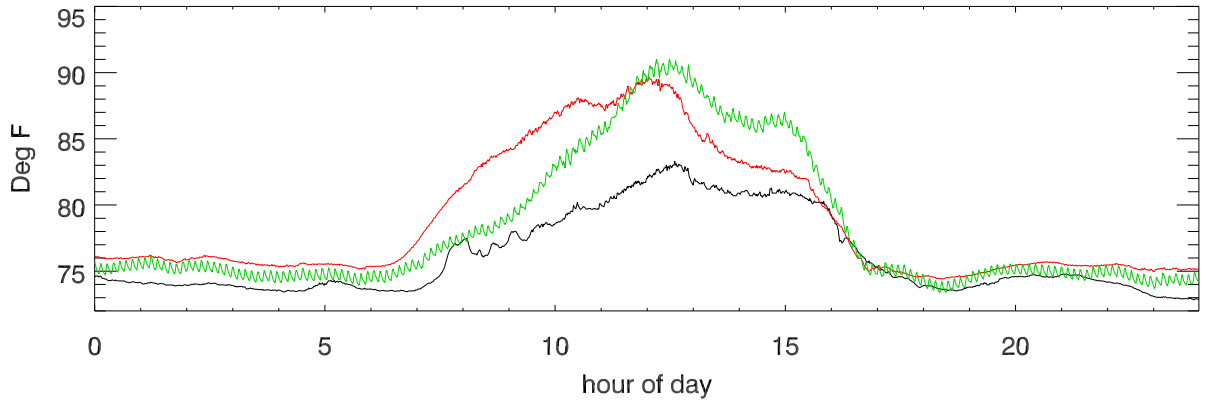


Cable temps vs hour of day. Main Cables for 20201025

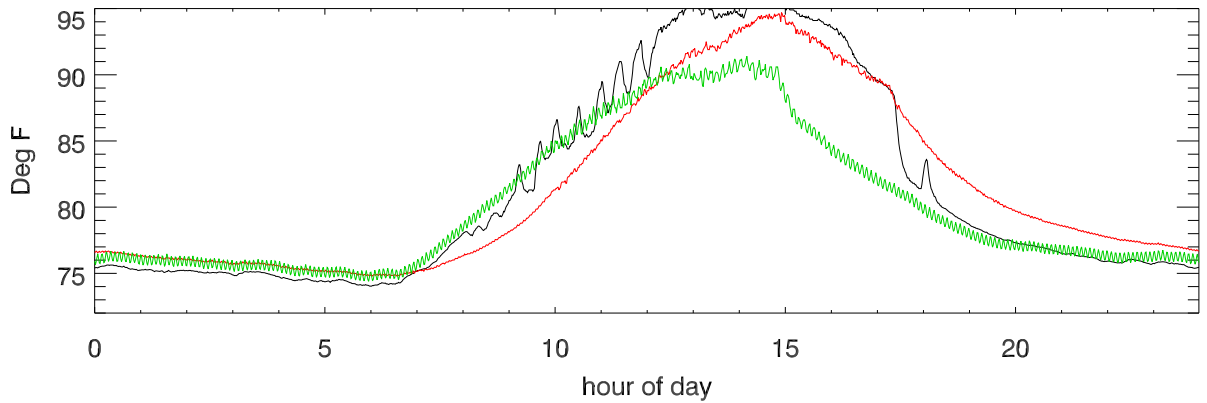


Backstay Cables for 20201025

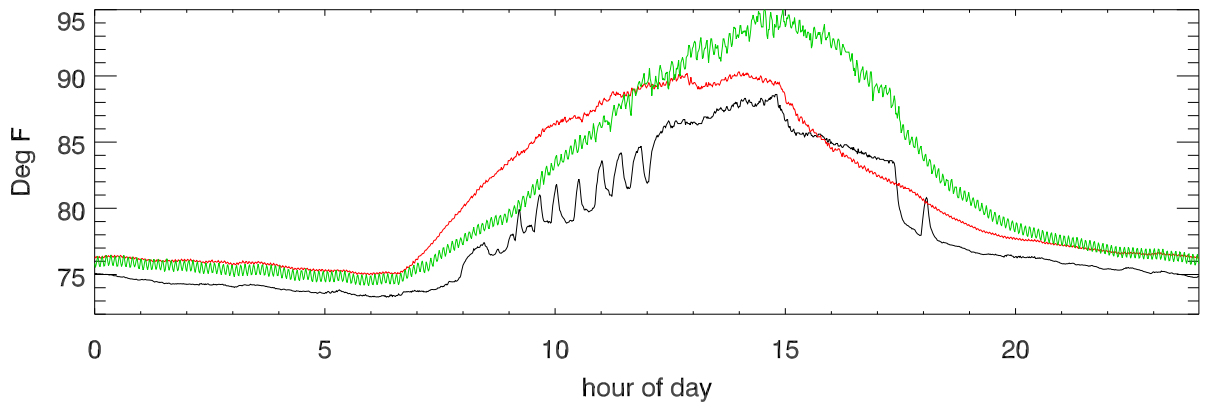


Temp - mean(temp) for 1st 100 minutes(samples). MainTemps

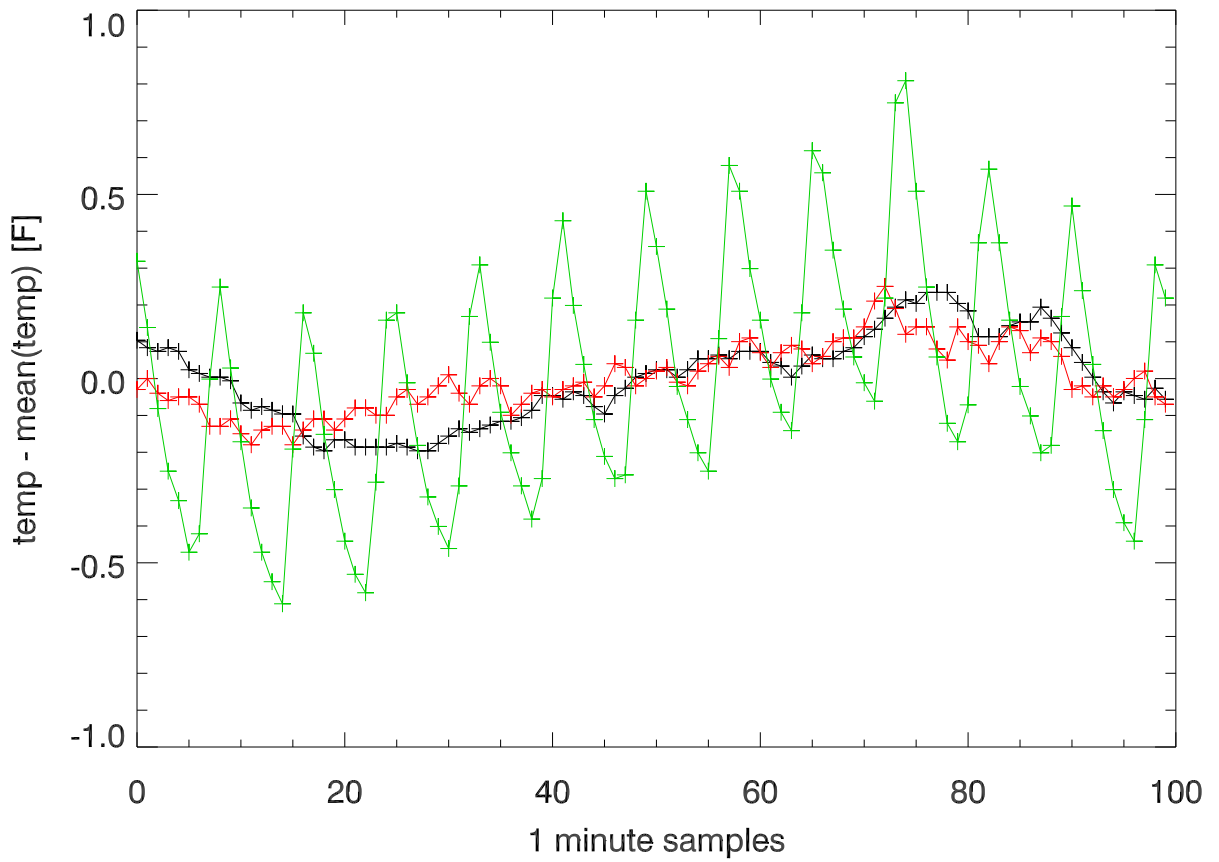


Temp - mean(temp) for 1st 100 minutes(samples). backstayTemps

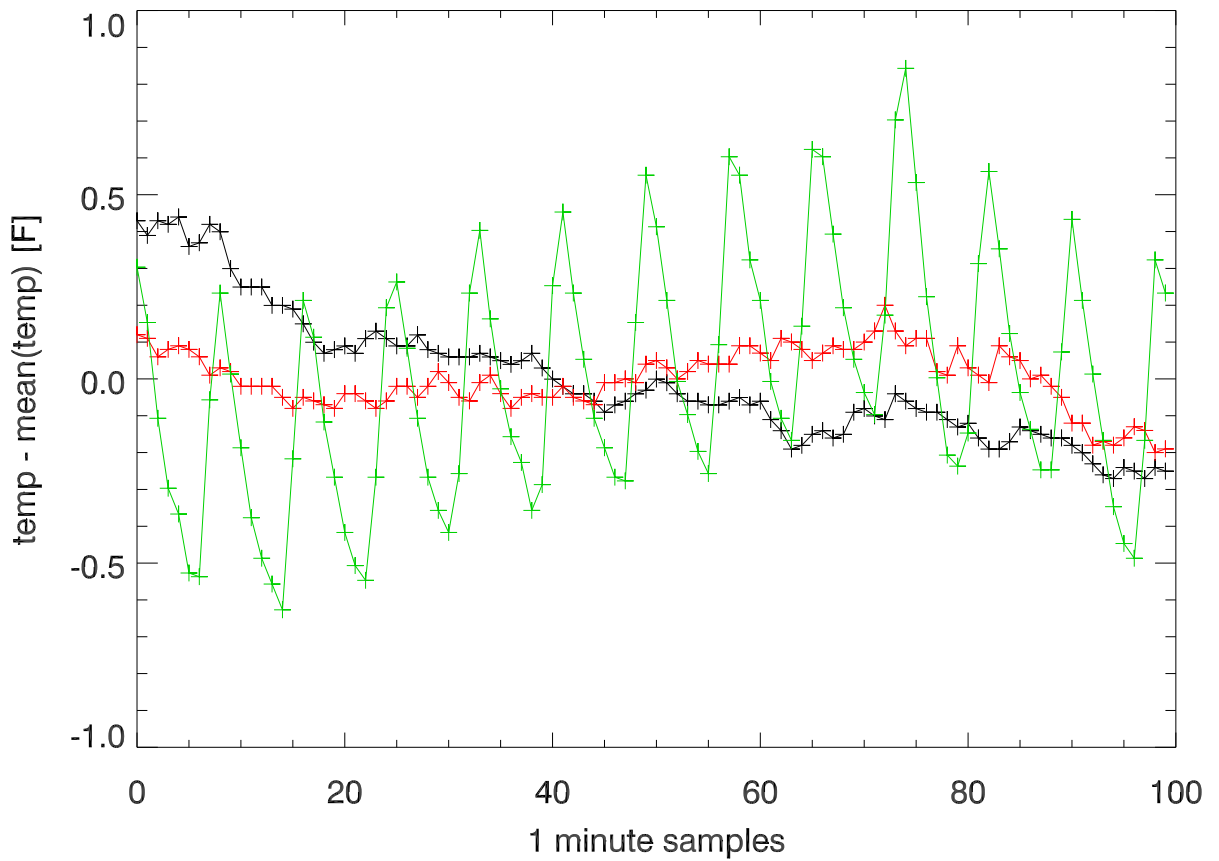


Freq spectrum of temps for 15 days of data. PlatformTemps

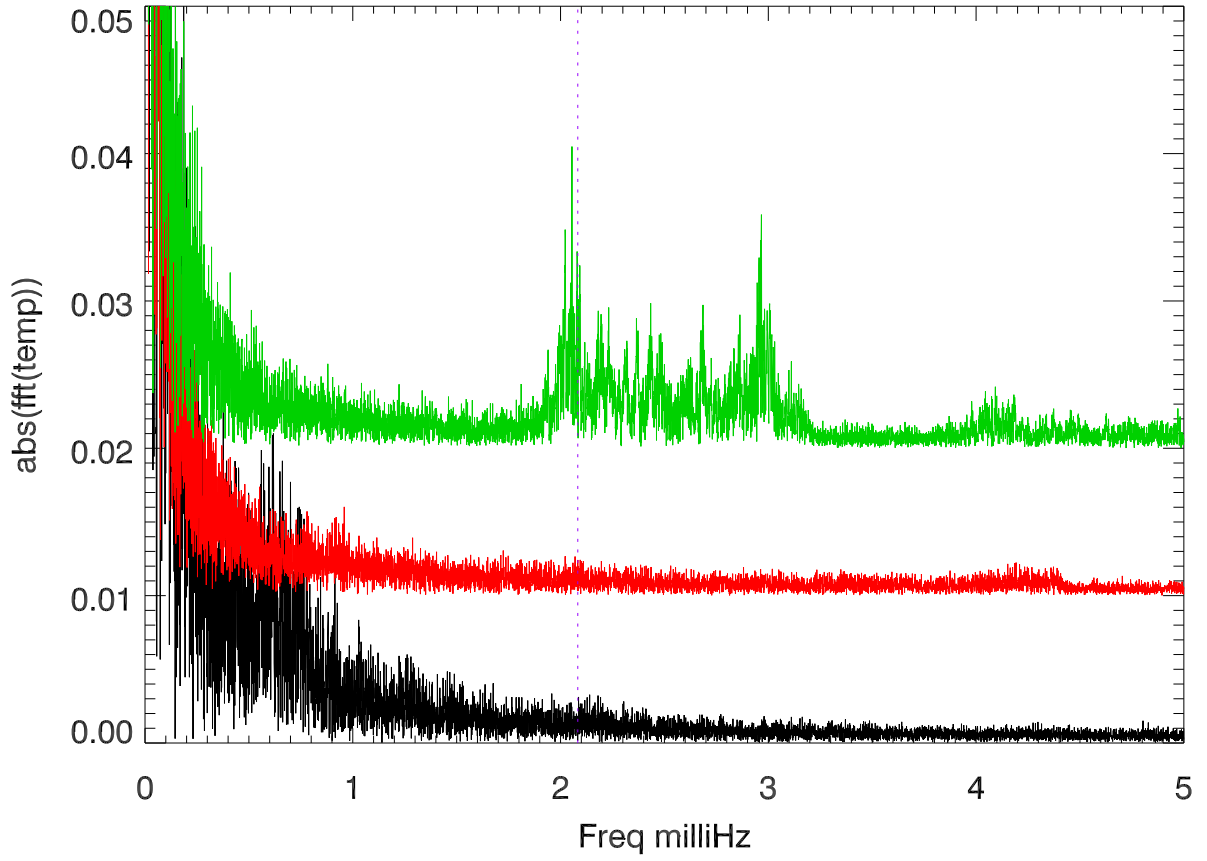


Freq spectrum of temps for 15 days of data. BackstayTemps

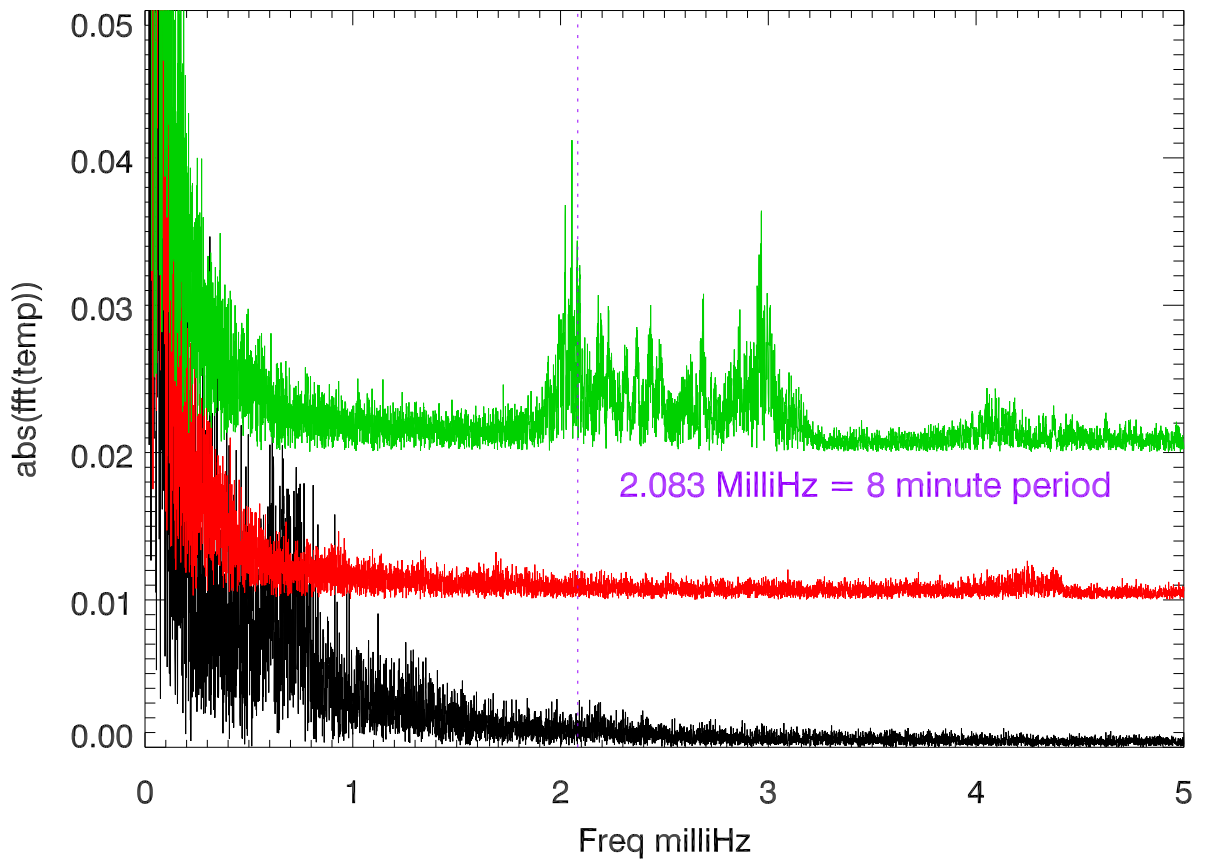


Main cable temps vs hour of day. Tower12

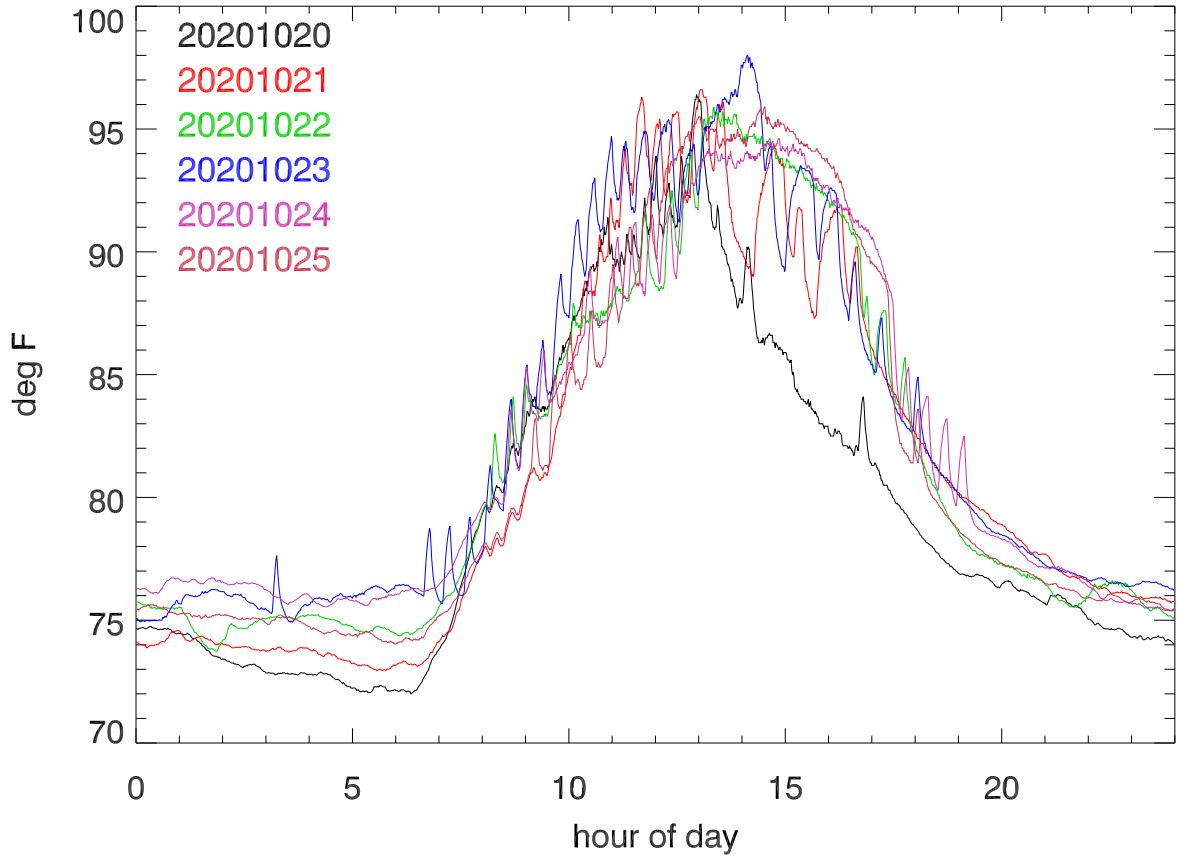

Main cable temps vs hour of day. Tower4

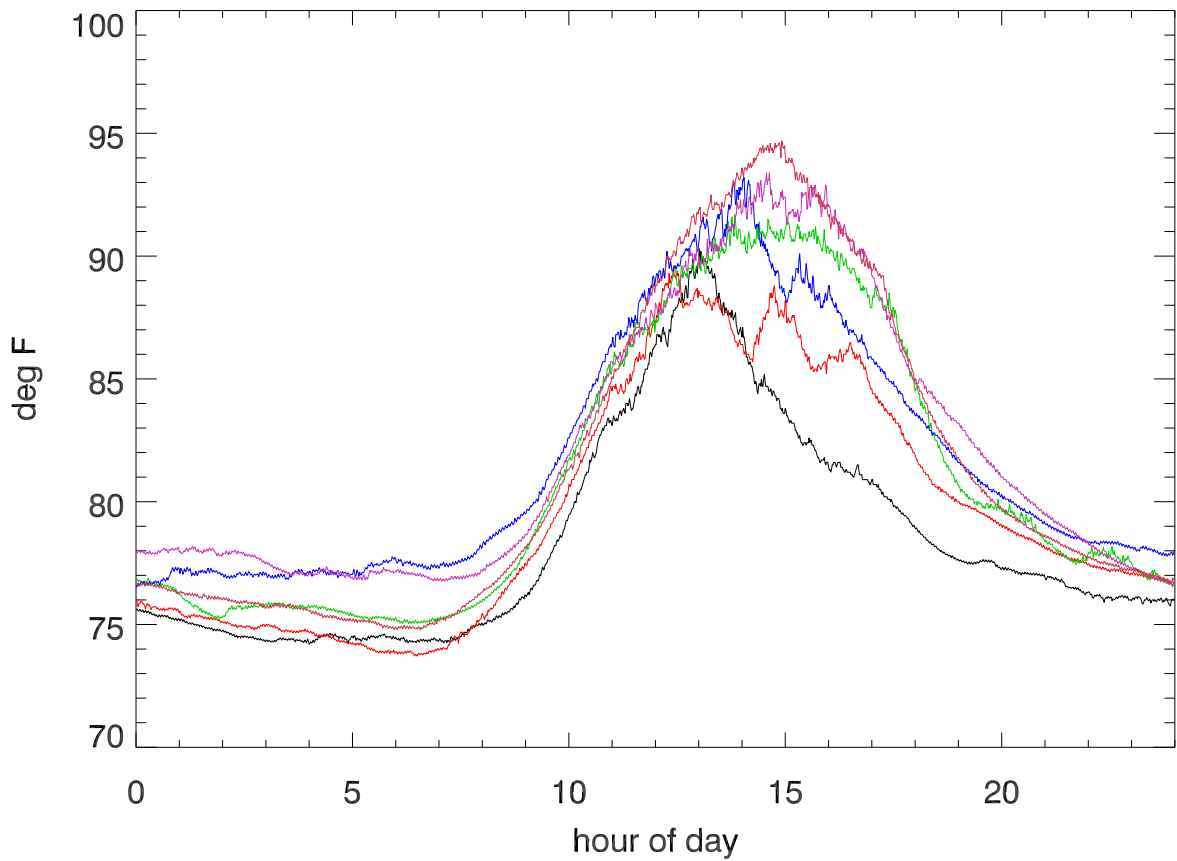

(Main cable temps -linear fit) vs hour of day. Tower12

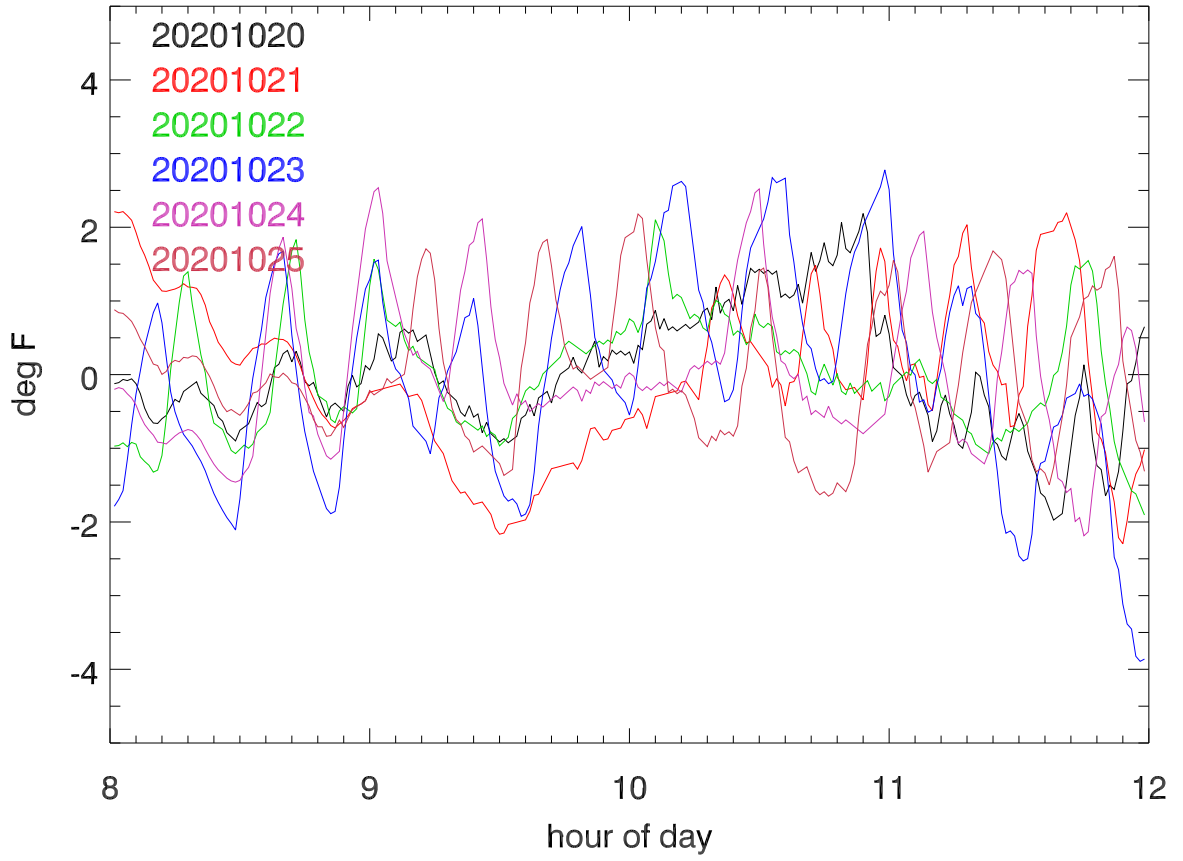

(Main cable temps -linear fit) vs hour of day. Tower4

