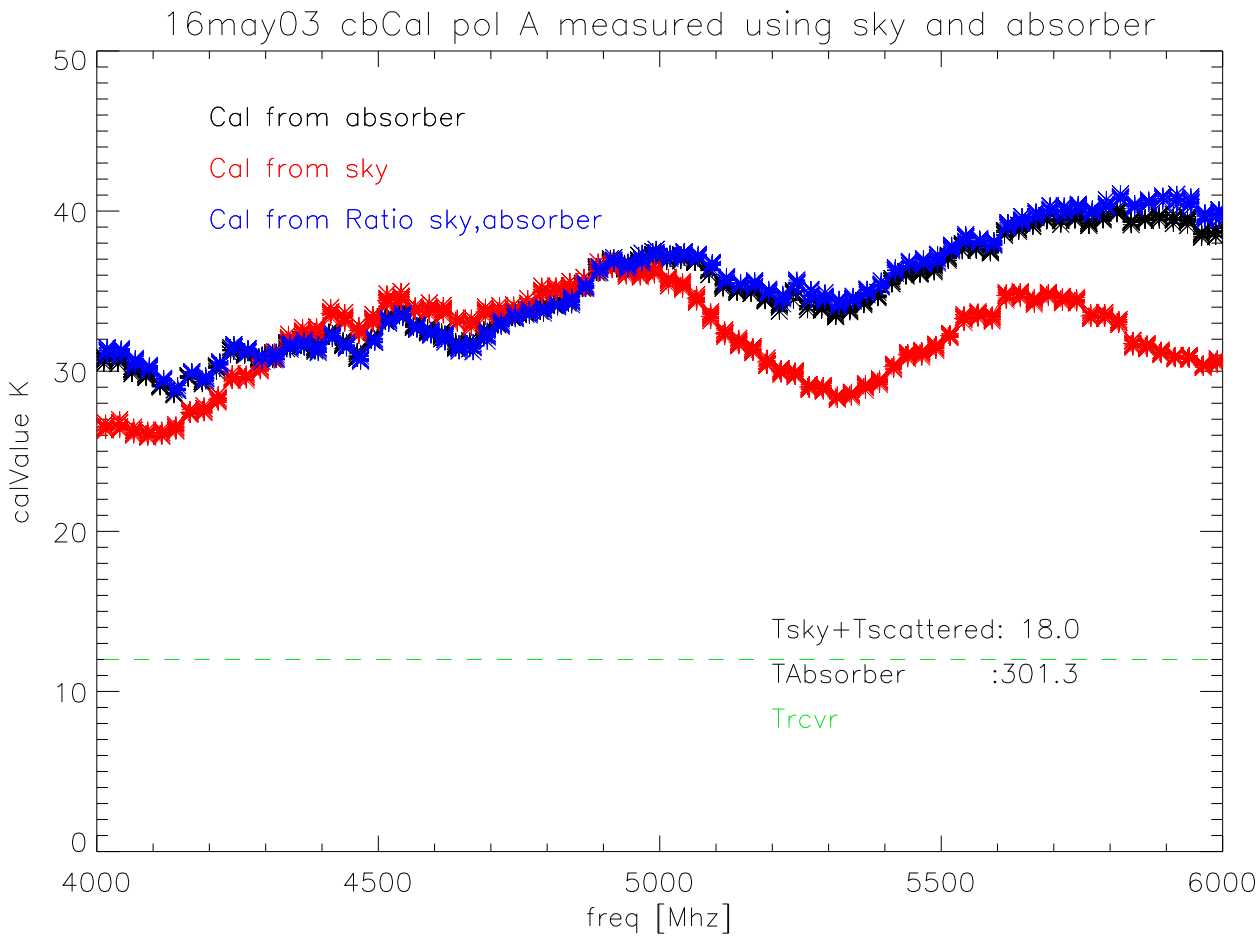
16may03 cbCal pol A measured using sky and absorber
Cal from absorber
Cal from sky
Cal from Ratio sky,absorber
Tsky+Tscattered: 18.0
TAbsorber :301.3
Trcvr
calValue K
freq [Mhz]
0
10
20
30
40
50
4000
4500
5000
5500
6000

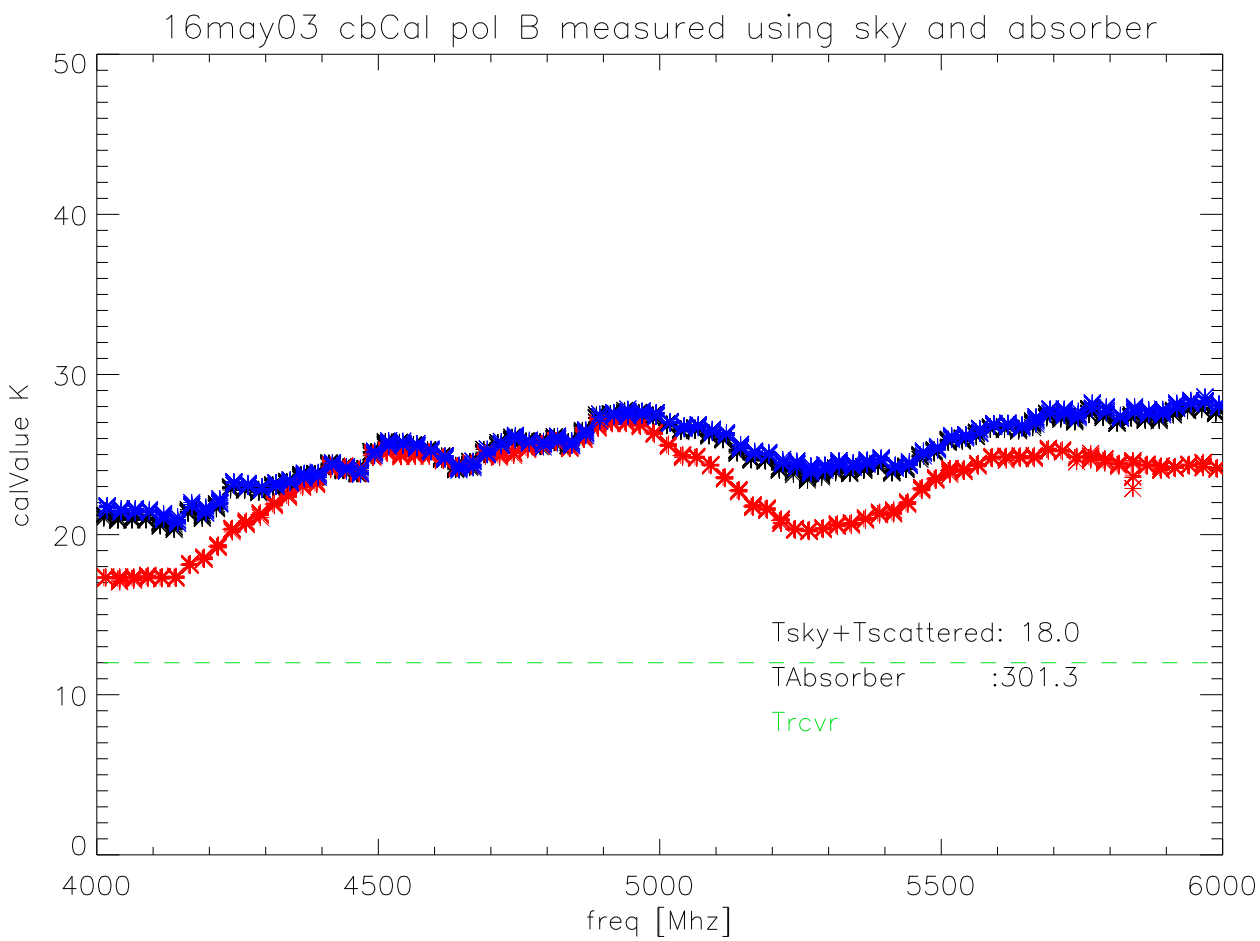
16may03 cbCal pol B measured using sky and absorber
Tsky+Tscattered: 18.0
TAbsorber :301.3
Trcvr
calValue K
freq [Mhz]
0
10
20
30
40
50
4000
4500
5000
5500
6000

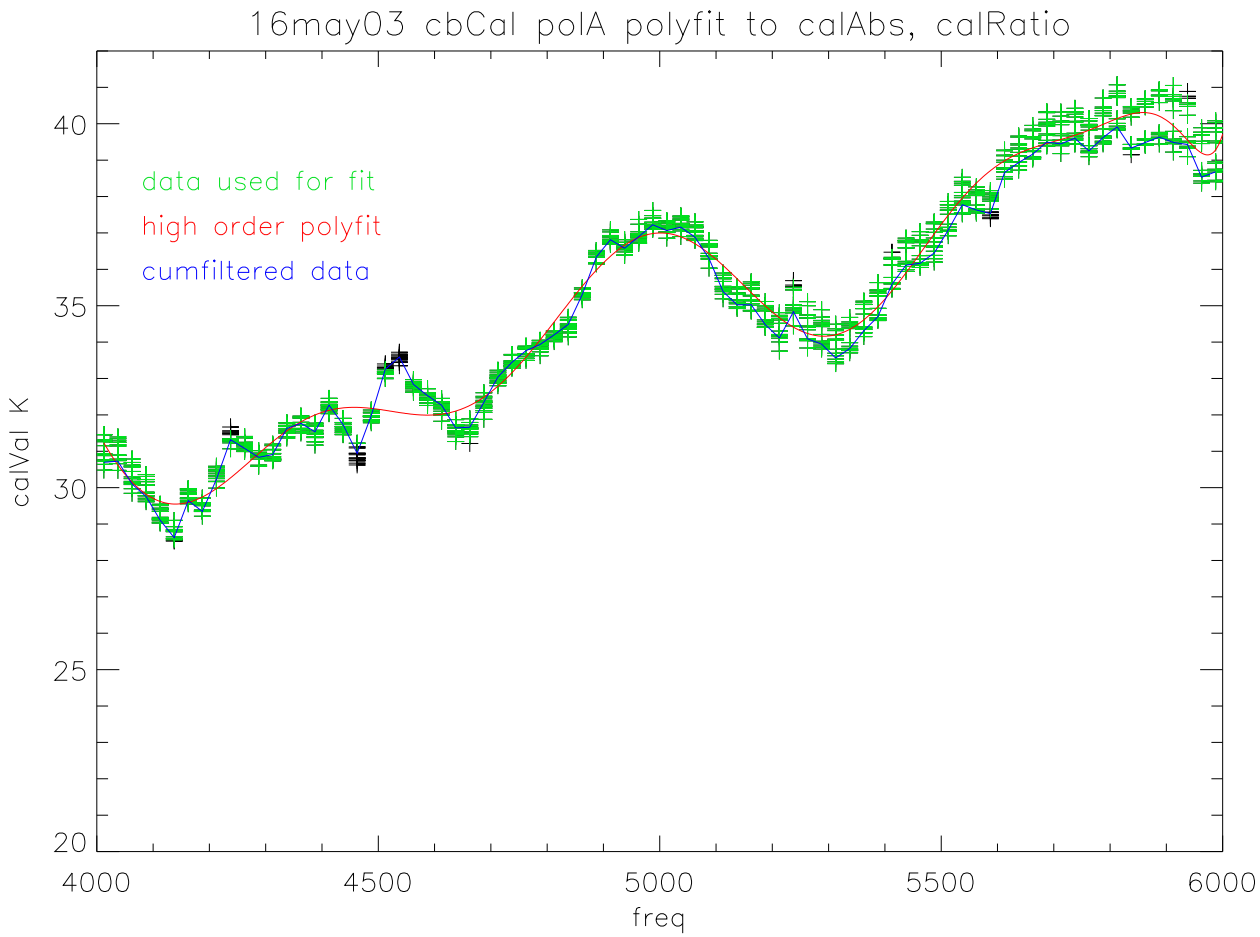
16may03 cbCal polA polyfit to calAbs, calRatio
data used for fit
high order polyfit
cumfiltered data
calVal K
freq
20
25
30
35
40
4000
4500
5000
5500
6000

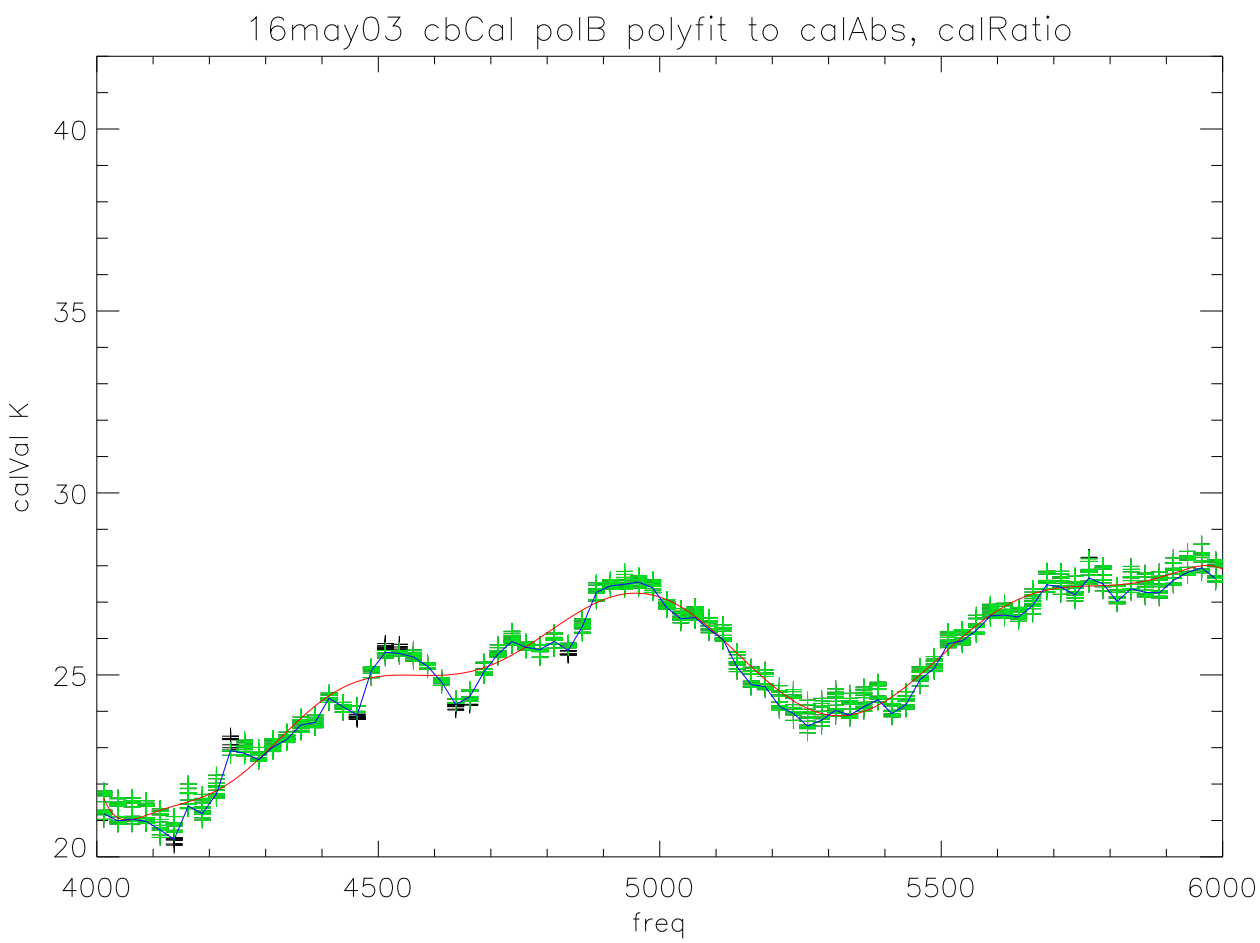
16may03 cbCal polB polyfit to calAbs, calRatio
calVal K
freq
20
25
30
35
40
4000
4500
5000
5500
6000

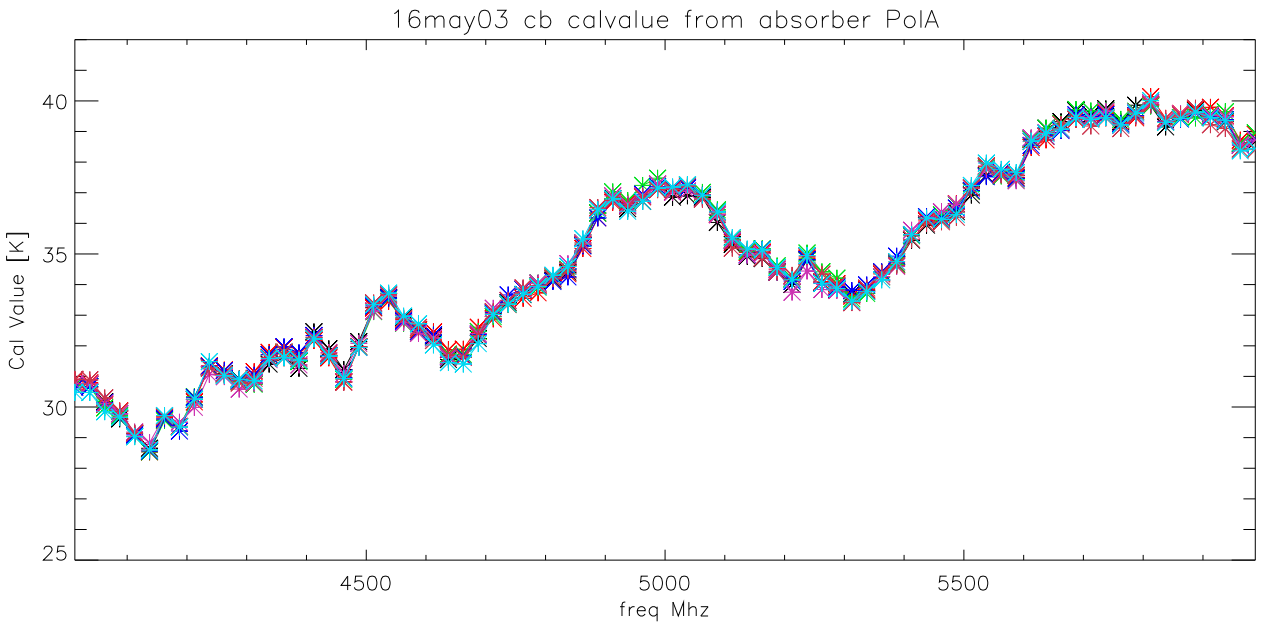
16may03 cb calvalue from absorber PolA
Cal Value [K]
40
35
30
25
4500
5000
5500
freq Mhz

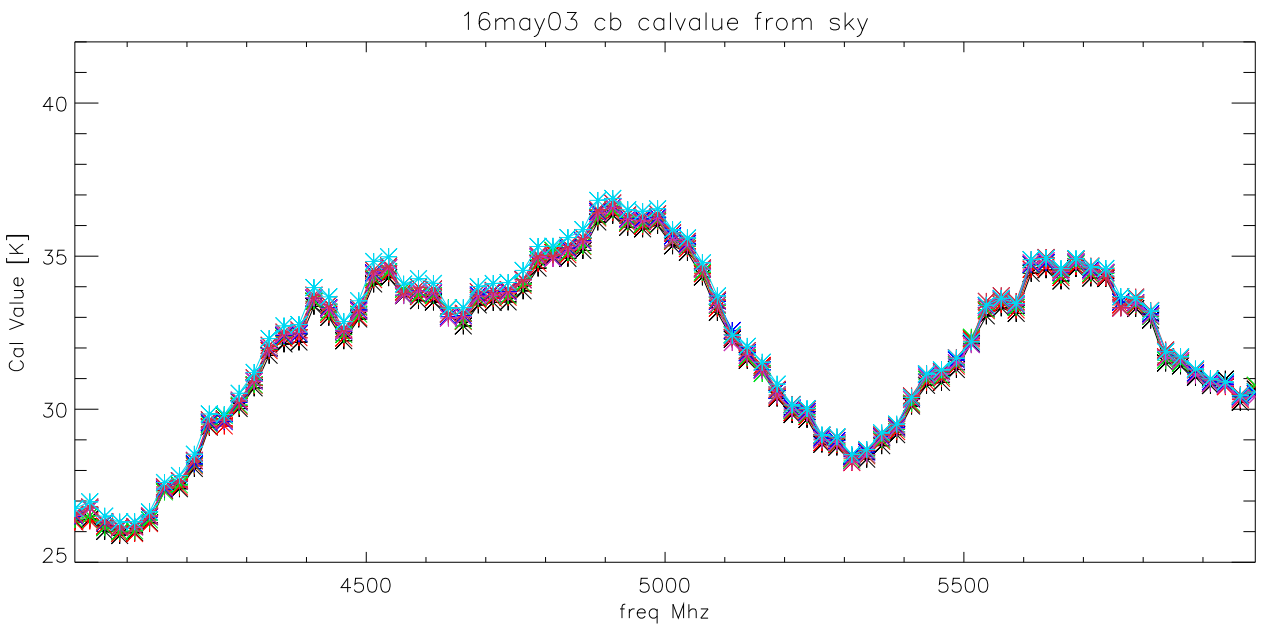
16may03 cb calvalue from sky
Cal Value [K]
40
35
30
25
4500
5000
5500
freq Mhz

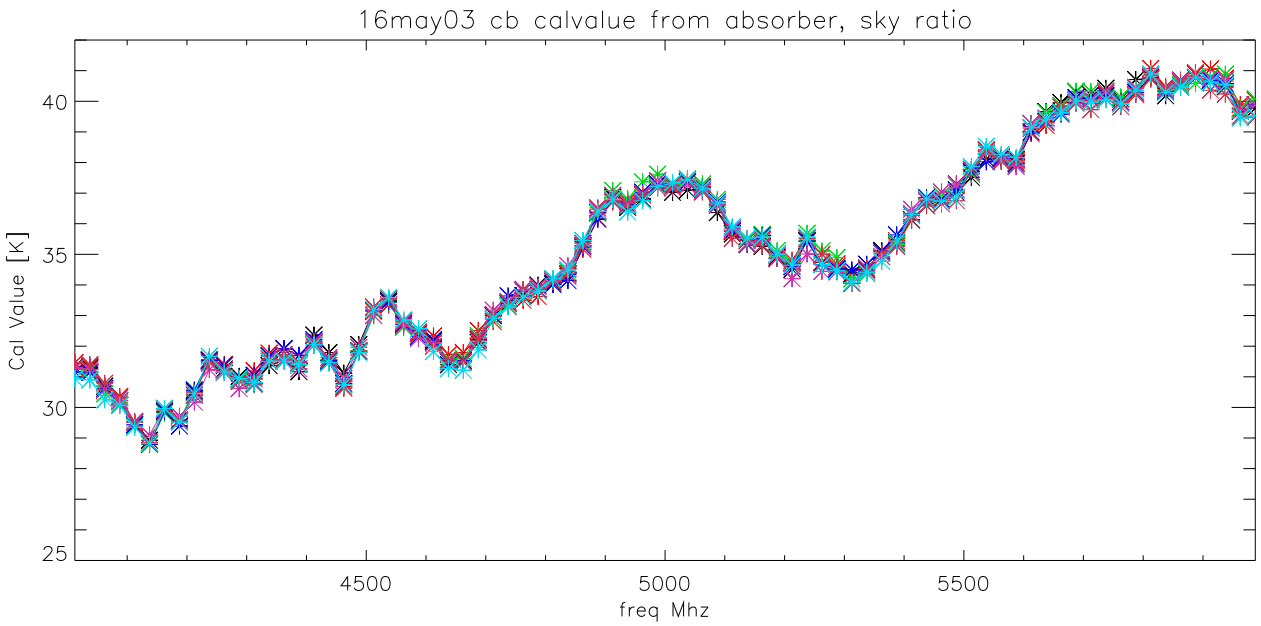
16may03 cb calvalue from absorber, sky ratio
Cal Value [K]
40
35
30
25
4500
5000
5500
freq Mhz

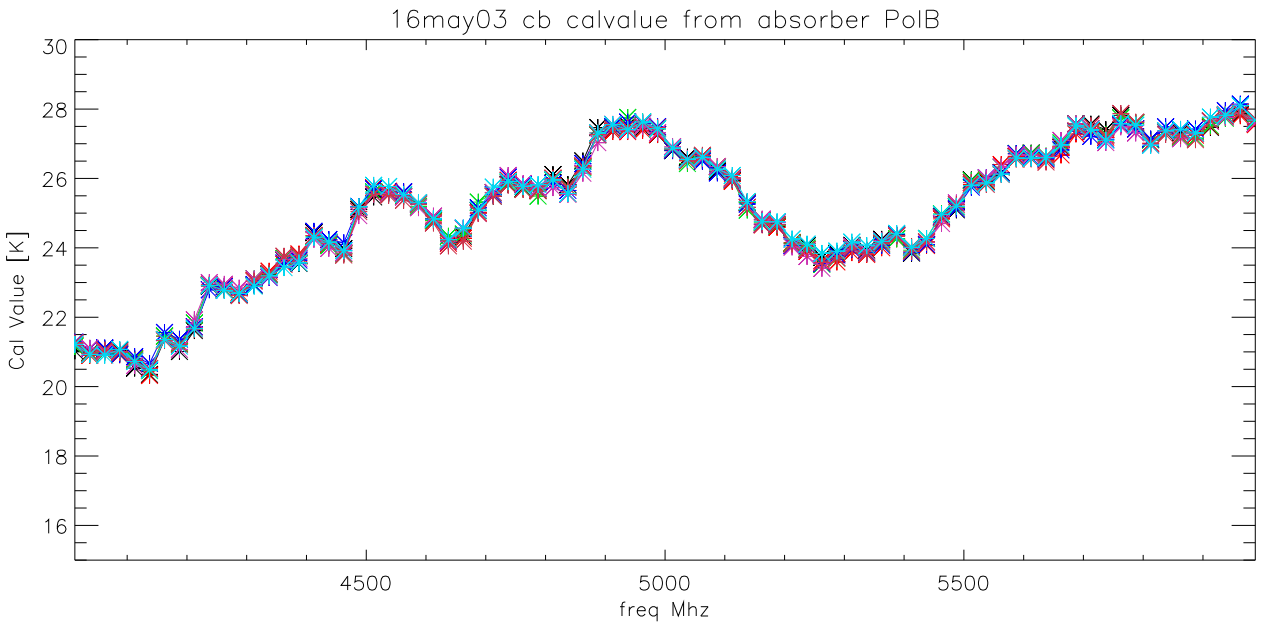
16may03 cb calvalue from absorber PolB
Cal Value [K]
freq Mhz
30
28
26
24
22
20
18
16
4500
5000
5500

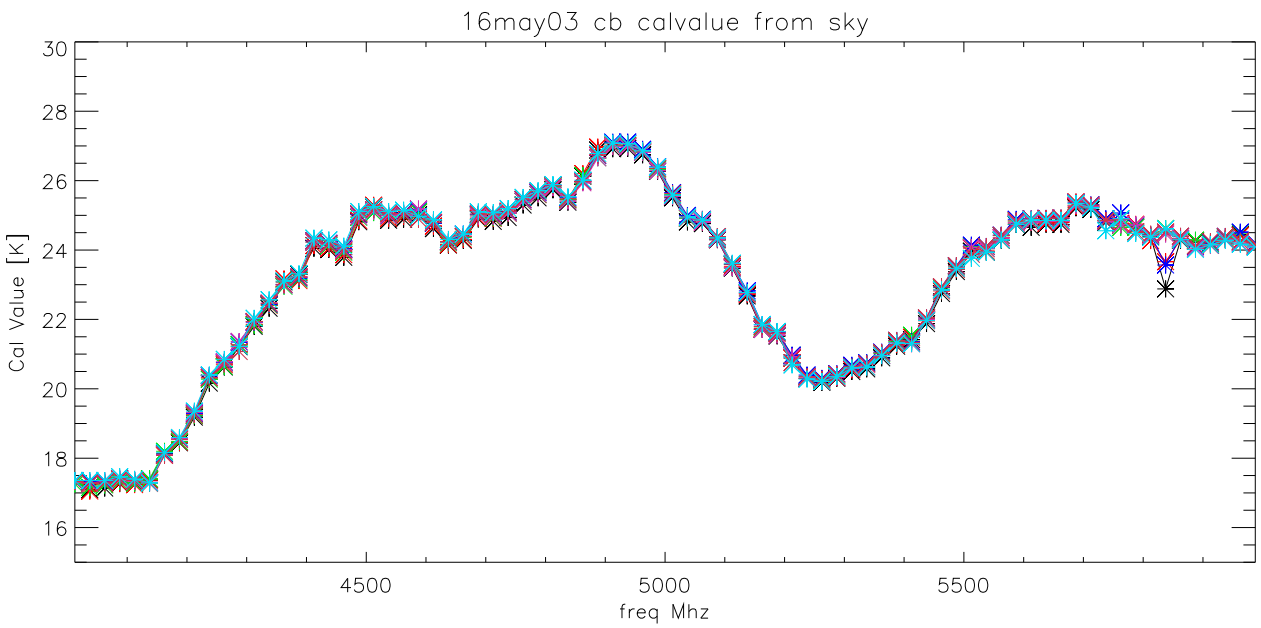
16may03 cb calvalue from sky
Cal Value [K]
freq Mhz
30
28
26
24
22
20
18
16
4500
5000
5500

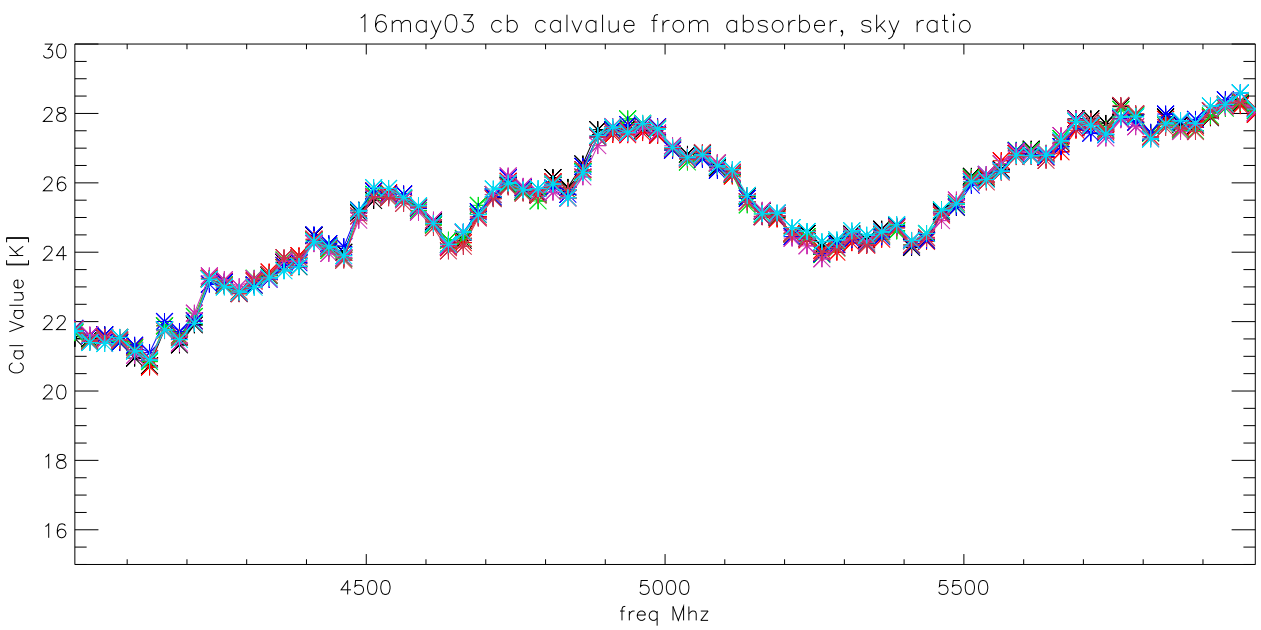
16may03 cb calvalue from absorber, sky ratio
Cal Value [K]
freq Mhz
30
28
26
24
22
20
18
16
4500
5000
5500