




230620 Measured cal value vs Freq PoIA

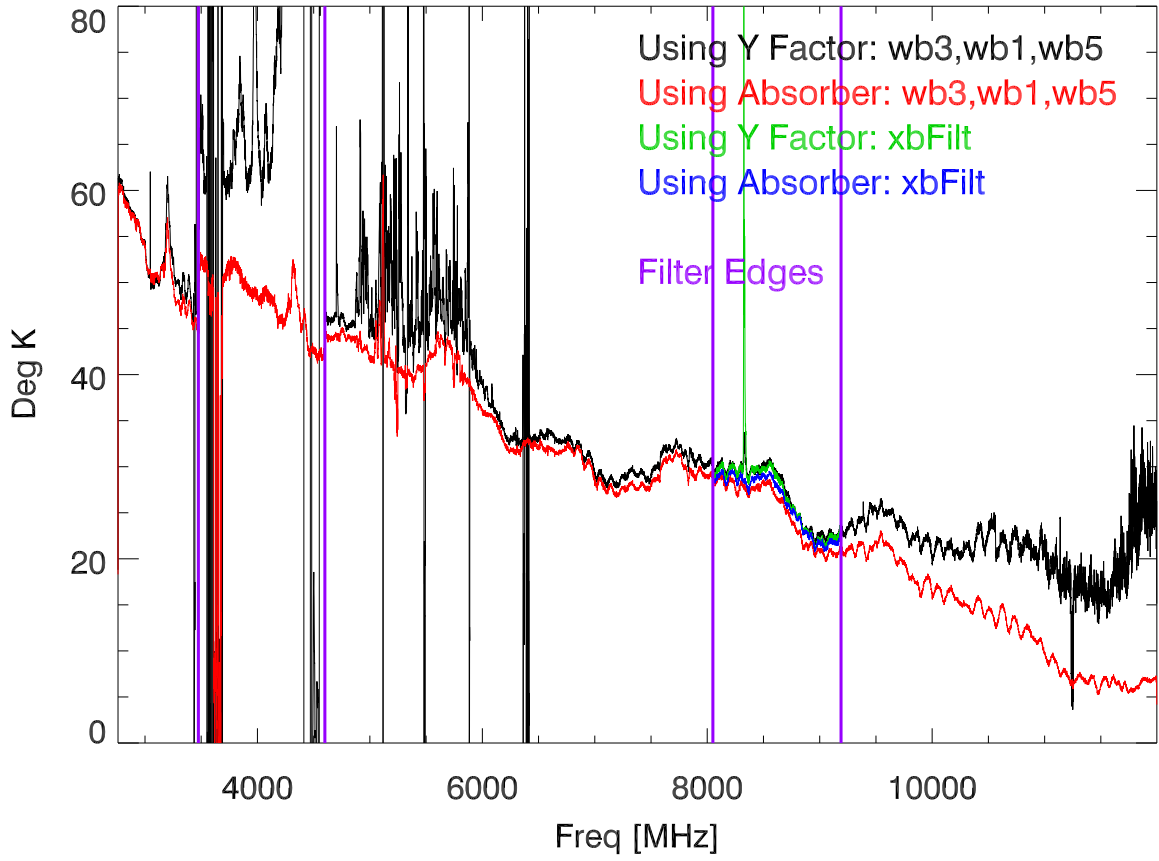


230620 Measured cal value vs Freq PoIB

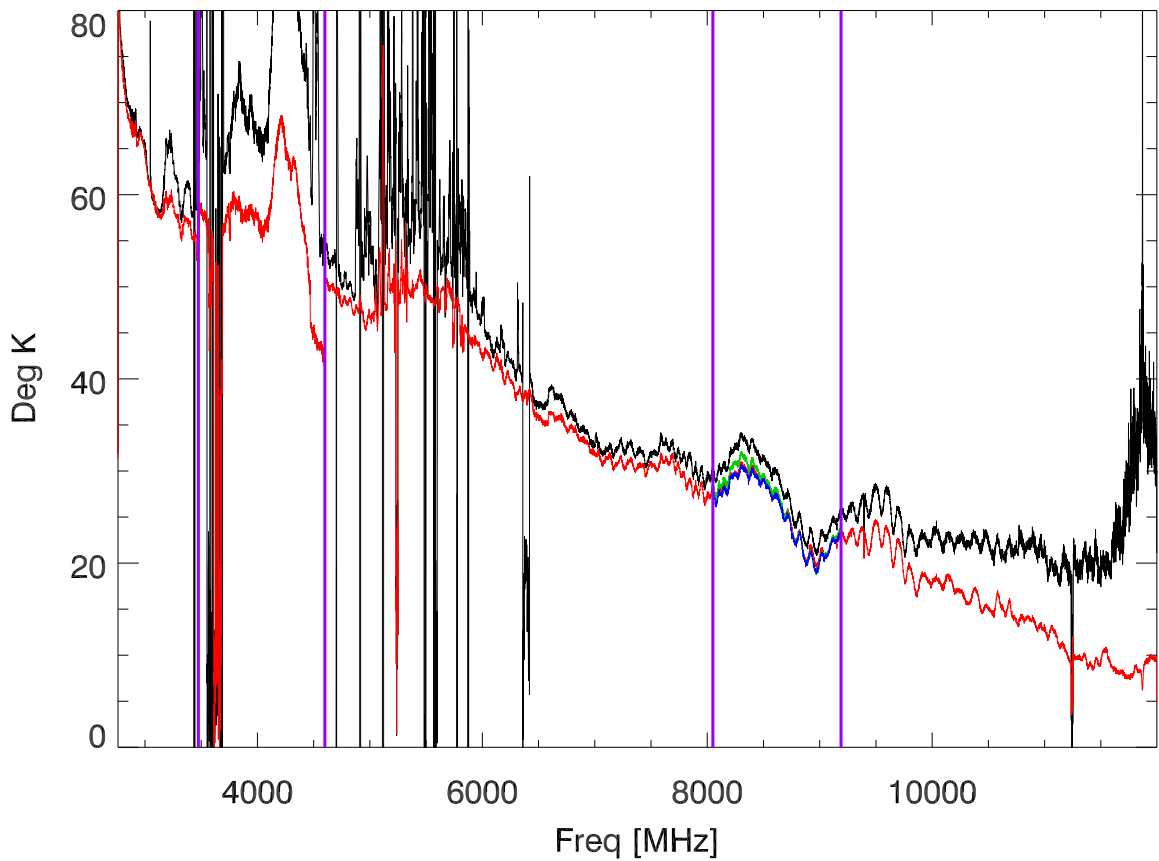


230620 Tcal vs freq for filt 3: 2775-3475Mhz PoIA

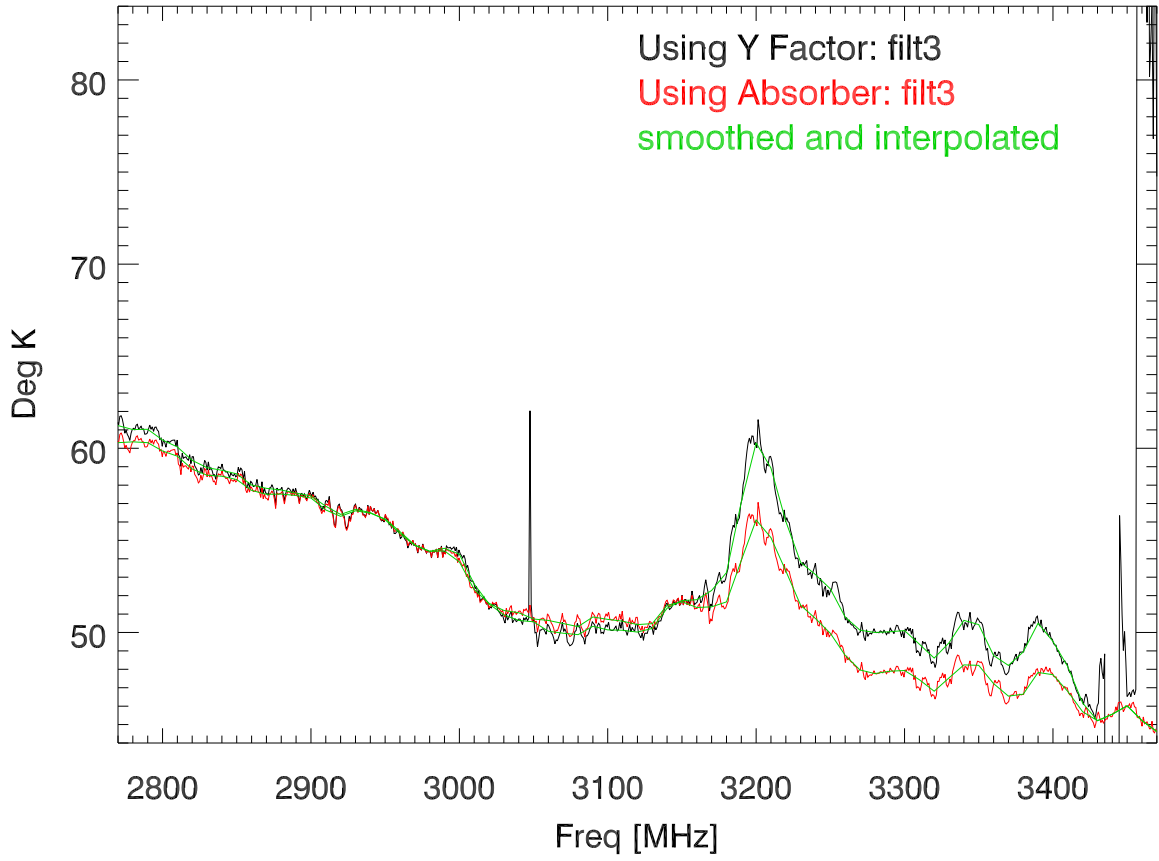

230620 Tcal vs freq for filt 3: 2775-3475Mhz PoIB

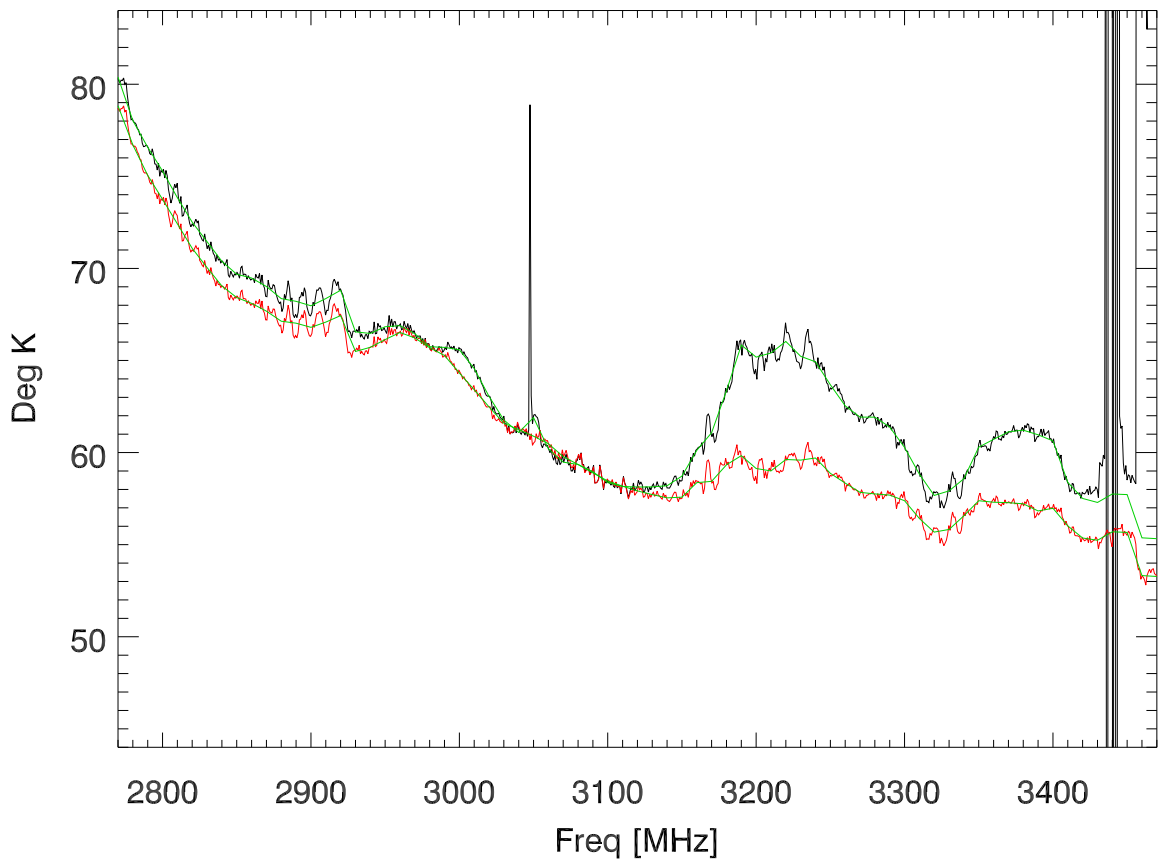

230620 Tcal vs freq for filt 6: 8050-9180Mhz PoIA

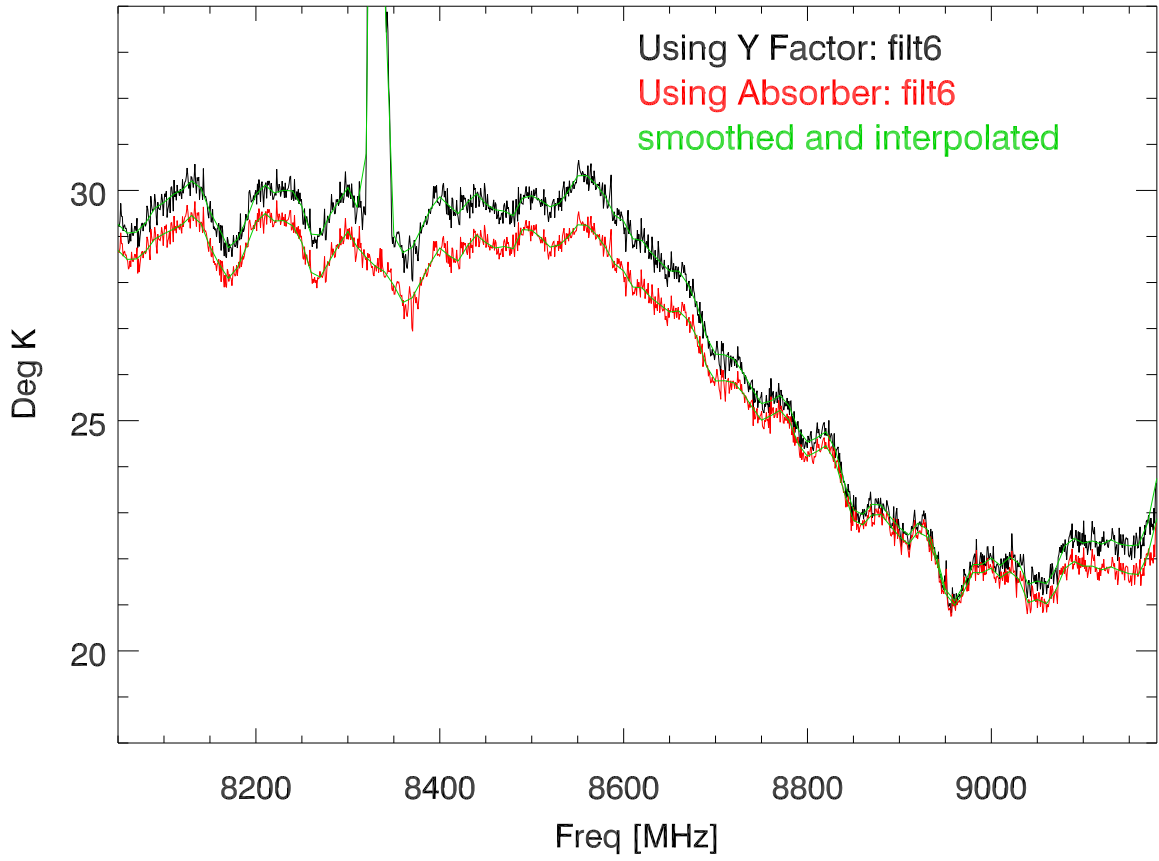

230620 Tcal vs freq for filt 6: 8050-9180Mhz PoIB

